Ka Shing Enterprise (H.K.) Ltd.



American Standard

PROJECT	REF	REV	ITEM CODE	
LOCATION	DATE		PAGE	

SANITARY WARE SPECIFICATION SHEET

American Standard (PRC) Concealed urinal Item Descriptions

sensor; AC operated for sea water

applications; ADM MODE; 24 hrs flushing system; Water flush volume 1.5 litres/cycle in WELS Grade 1; Registration No. 1U 19-

0004

Dimensions L135 x W104 x H135 mm

Model WF-8014.0S0.50

Finish Chrome Plated

Manufacturer American Standard (PRC)

Ka Shing Enterprises (H.K) Limted Source

Mr. Ivan Lau / Mr. GilmanYuen

Contact Tel/Fax (852) 2628-0661 / (852) 2490-2700

E-mail project@kashingehk.com Website www.kashingehk.com

Specification:-

Power supply: 110-240V AC

Mode of the inducing: a. Infrared Induction b. ADM Mode"

Detects Range (Default): 40CM Detects Time: 3 Seconds

Flush Time: Pre-Flush1.5 seconds/ Second Flush 8 Seconds


Flush Volume: 4L or Less

Pressure Requirement: 0.1Mpa ~ 0.75Mpa

Pipe Size: G 1/2"

Environment Temperature: $1^{\circ}C \sim 40^{\circ}C$ Acceptable Water temperature: 1°C ~ 40°C

Wall Opening: 116 x 116 x 104mm

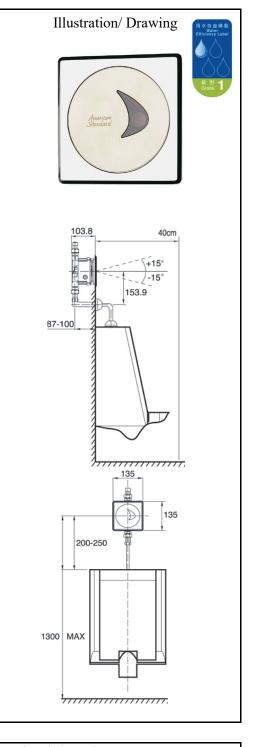

WF-8014.0S0.50= WF-8004.0S0.50 (WSD approved) + AC circuit board

^{*} All information of the above is for the reference only. No prior notice is made if any changes.



自願參與用水效益標籤計劃 - 小便器刀具 Voluntary Water Efficiency Labelling Scheme - Urinal Equipment

rtificaté

This is to certify that

WF-8014.0S0.50 = WF-8004.0S0.50 (WSD approved) + AC circuit board

> 將下列小便器用具在本計劃內註冊: has registered the following urinal equipment under this scheme:

牌 / Brand

American Standard

型 / Model

WF-8004.0S0.50

/ Category

原產地 / Country or Region Origin

China

在用水效益標籤上展示的標誌

Symbolic Presentation on the Water Efficiency Label

滴水點

Water droplet(s)

用水效益级别

Water Efficiency Frade

种水母

Water Flush Tolume

1.5

公升/循環 litres/oyde

簽發日期: Date of Issue:

22 March 2019



Water Supplies Department

水務署署長(張業駒代行)

The above urinal equipment is operated with a smart demand operation to achieve additional

for Director of Water Supplies



水 務 署 Water Supplies Department

總部 Headquarters

香港灣仔告士打道七號入境事務大樓 48 樓

48/F, Immigration Tower, 7 Gloucester Road, Wan Chai, Hong Kong

本署檔號 Our ref. 來函檔號

Your ref.

(4) in WSD 3321/2021 T/J(1735/2021)

電話

Tel. 傳真

Fax.

2824 0578

18 March 2022



Dear Sir,

Approval of "AMERICAN STANDARD" Sensor Flush Valves (General Acceptance No. C20220209F)

Your letters ref. WRC/2691 and C-WSD/0902 dated 30 November 2021 and 14 February 2022 respectively refer.

Having considered the test report ref. J24959Ar2 issued on 14 January 2022 by Nutek Systems (HK) Limited, this Authority accepts that the fittings described below comply with, and their use when correctly installed does not contravene, the Waterworks Ordinance and Regulations.

Name of Manufacturer:

American Standard

Country of Origin:

the Mainland of China

Brand:

American Standard

Details of Fitting:

1/2" Sensor flush valve for urinal

Model:

WF-8004.0S0.50

WF-8014.0S0.50

Body Markings:

American Standard

Expiry Date:

4 November 2026





Proviso:

As the fittings have not been tested for use in contact with water intended for human consumption, the fittings can only be used in flushing water plumbing system.

This Authority hereby permits the use of the above fittings in flushing water plumbing systems subject to full adherence to Waterworks installation requirements. In particular, you are required to draw your customers' attention to the following requirement-

"Installation of filter before flushing valve is required. Without the filter, the flushing valve is liable to leak. The installed filter need frequent inspection and cleaning to maintain flushing supply. Normally only public toilets with good management system for maintenance would be considered."

"A stop cock or gate valve must be installed at the upstream of the fittings for manual isolation of water supply."

"The design flushing volume of the flushing valves should be compatible with the toilet bowl to ensure that effective clearance can be achieved by a single flush of water."

"Flushing valve should be used within the range of working pressures specified by the manufacturer." AND

"Installation of electronic opening and closing sanitary tapware should also comply with the requirements of Electrical & Mechanical Services Department."

A condition of this acceptance is that the fittings to be installed shall be replicas of the samples as certified by the testing agent mentioned above and without modifications. This acceptance may be withdrawn at any time if the standard of the fittings installed fails to meet that of the approved samples or if the fittings are found to be unsuitable for use in flushing water plumbing systems.

For the use of the fittings in any project, the General Acceptance Number of this letter must be quoted as a means of identification of acceptance of the fittings by this Authority.

Should you have any enquiries, please contact our Engineer Ms Winnie LO at tel. no. 3583 4086.

Yours faithfully,

(YA'U Hau Yin)

for Director of Water Supplies

Encl.

c.c. WSD 3321/1/82] - without catalogue ME/MC] - with soft copy only