



PROJECT		REF		REV	ITEM CODE	
LOCATION		DATE			PAGE	

SANITARY WARE SPECIFICATION SHEET

Item Descriptions

SODUN (PRC) Ø32 x 750 mm long stainless steel 304 grab bar in satin finish ; capable of carrying a static loading test 150kg ;test report J29855;complied with Barrier Free Access 2008

Illustration/ Drawing



Dimensions

32mm dia x 750 mm long

Model

AG-033H

Finish

Stainless Steel

Manufacturer

SODUN (PRC)

Supplier

Ka Shing Enterprises (H.K) Limited
Mr. Ivan Lau / Mr. GilmanYuen

Contact Tel/Fax




(852) 2628-0661 / (852) 2490-2700

E-mail


project@kashingehk.com

Website

www.kashingehk.com

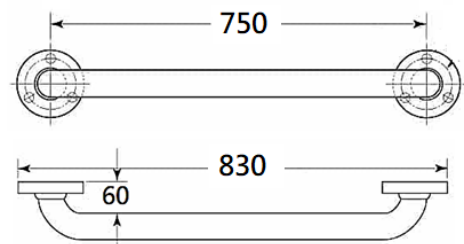

Wood screws (8)



Note:

* All information of the above is for the reference only. No prior notice is made if any changes.

Test Report

TITLE : Loading test
 REPORT NO. : J 29855
 DESCRIPTION OF SAMPLE : 1-1/4" x 30cm Grab bar
 SAMPLE SUBMITTED BY : Ka Shing Enterprises (H.K.) Limited
 Unit A, 3/F, 30-38 Tsuen King Circuit,
 Waylee Industrial Centre, Tsuen Wan, N.T.
 Chai Wan Kok, N.T. Hong Kong
 BRAND : Sodun
 COUNTRY OF ORIGIN : CHINA
 MODEL : AG-033H
 METHOD OF TESTS : Loading test
 PERIOD OF TESTS : 09 May, 2024

RESULTS: (apply only to the sample tested)

1. Load test

The sample was installed onto a concrete wall in its normal application (cement to GB 175-2007). A test load was applied to the mid-point of the sample which was then examined for any signs of damage.

	Weight/ downward load (kg)	Test duration (min)	Break/failure/ deflection/crack	Remark
Sample	150	30	No	PASS
Required	150	30	No	---


Note:

The sample is capable of carrying the static load as per requirement of Clause 53, Design Manual: Barrier Free Access 2008 (2021 Edition).

Date: 17 May, 2024

Nutek Systems is a testing agency, accepted by the Water Supplies Department, for testing water supply fittings.

Authorized
Signature:



Lam Kwai Wah, Terry
(Operations Manager)

REPORT NO.: J 29855



Figure 1 - Sample

- End of report-